

Electric boilers TK-Profesional 70 ÷ 100kW

Electric boilers TK-Profesional power 70, 80, 90, 100kW are compact devices designed for heating of several residential or commercial buildings. The boiler is made of steel sheet, and the steel components are also integral (flanges, hamburger arch, mufov, knives, etc.). It was tested at a pressure of 6bar, and max. operating pressure is 4bar. The flanges with which the boiler is connected to the heating installation are located on the back of the boiler. On the return tube of the boiler (bottom) there is a tap for charging and discharging, and on the pressure pipe (upper) a safety valve 4bar and an automatic bleed valve.


The outer shell of the boiler is made of decapitated sheet metal, protected by the electrostatic plasticization process. On the front there are doors that cover the dashboard and doors that cover the distribution board.

On the dashboard there is a main switch for the boiler, a safety thermostat, a signal light and a microprocessor thermoregulator with LCD display on which the given and current values of the parameters of the system are constantly displayed. The microprocessor thermoregulator provides precise measurement and maintenance of the temperature during operation, as well as intelligent control of the operation of the heaters.

The lower door covers a distribution board with a complete boiler control and regular terminals to which the power supply cable is connected, as well as auxiliary terminals for connecting the circulation pump and operating conditions (room thermostat or the like). The lower door must be closed during operation of the boiler, and the access to the complete automation covered by it is permitted only to an expert person.

Protective elements: The boilers are equipped with a " Multistage protection " protection system that permanently monitors temperature and pressure in the system, in the case of approaching the pressure or temperature of the unauthorized values, displays the appropriate warnings in the display, and in case of exceeding the pressure values of the pressure or temperature, all heaters are switched off, or in the third degree of shutdown, the complete power supply of the device with voltage triggers is turned off, which guarantees safety.


Technical characteristics		70kW	80kW	90kW	100kW
Dimensions	A	1240mm	1240mm	1240mm	1240mm
	B	500mm	500mm	500mm	500mm
	C	650mm	650mm	650mm	650mm
Weight	92kg	106kg	110kg	120kg	
Volume of the court	95ℓ	95ℓ	95ℓ	95ℓ	
Heaters	7×10kW	8×10kW	9×10kW	10×10kW	
Heat groups	7×10kW	8×10kW	9×10kW	10×10kW	
Connection voltage	3N ~ 400V 50Hz	3N ~ 400V 50Hz	3N ~ 400V 50Hz	3N ~ 400V 50Hz	
Connection to the hydraulic net	DN50 (2"); PN 16	DN50 (2"); PN 16	DN50 (2"); PN 16	DN50 (2"); PN 16	
Min and Max operating pressure	0,4 bar - 4 bar	0,4 bar - 4 bar	0,4 bar - 4 bar	0,4 bar - 4 bar	
Safety valve	3/4" 4 bar	3/4" 4 bar	3/4" 4 bar	3/4" 4 bar	
Degree of protection	IP 20	IP 20	IP 20	IP 20	
Working temperature	10 - 90 °C	10 - 90 °C	10 - 90 °C	10 - 90 °C	
Security thermostat	95 °C	95 °C	95 °C	95 °C	
Fuses of heaters	7 × 3P C25A	8 × 3P C25A	9 × 3P C25A	5 × 3P C40A	
Max rated current	3 × 101,5A	3 × 116A	3 × 130A	3 × 145A	
Required main fuses	3 × 125 A	3 × 125 A	3 × 160 A	3 × 160 A	
Need a cable to connect	Cu 3 × 50 mm ²	Cu 3 × 70 mm ²	Cu 3 × 70 mm ²	Cu 3 × 70 mm ²	
Required protective circuit	Cu 1 × 25 mm ²	Cu 1 × 25 mm ²	Cu 1 × 35 mm ²	Cu 1 × 35 mm ²	

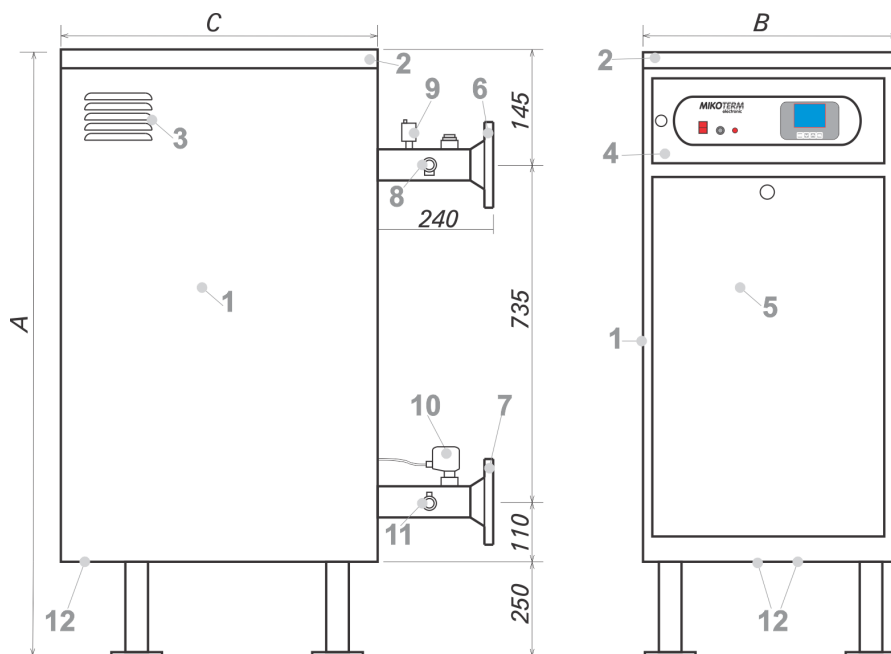

Legend:

- 1) Boiler wrapper
- 2) Boiler cover
- 3) Ventilation blinds
- 4) Dashboard door
- 5) Door distribution panel
- 6) Pressure line: flanged flange DN50
- 7) Return line: flanged flange DN50
- 8) Safety valve
- 9) Automatic bleed valve
- 10) Optional - flow switch 1" (control: 6÷15,6m³/h)
- 11) Taps for charging and discharging 1 1/2"
- 12) Cable glands


Minimum dimensions of free space for boiler installation

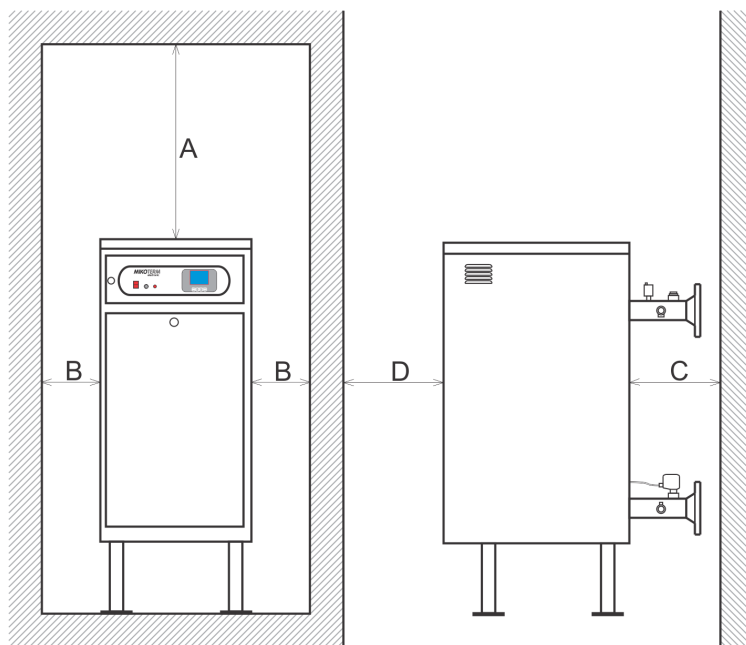

A=700mm / B=500mm / C=700mm / D=1000mm

Distribution of components on the switchboard


Example: Electric boiler power 90kW (The number of contactors and automatic fuses depends on the power of the boiler)

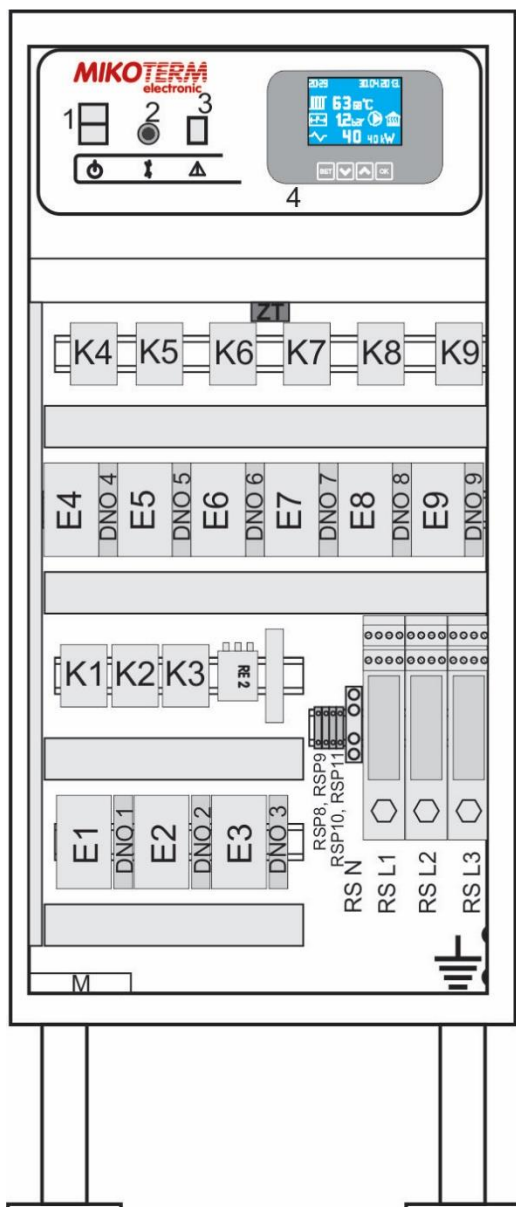




Legend:

- 1 - Main switch
- 2 - Safety Thermostat (95 ° C)
- 3 - Signal bulb overheating
- 4 - Microprocessor thermoregulator EK_CPU_1_3
- ZT - Protection thermostat for boiler control
- K1, ..., K9 - Contactor
- E1 + DNO1, ..., E9 + DNO9- Safety circuit
- EA - Control circuit fuse
- RE 2 - Safety Relay
- RS L 1 - RS L 3 - Straight terminal terminals of the power cable phase conductors (70mm²)
- RS N - Regular Nozzle Clamp (35mm²)
- RSP 10, RSP 11 - Connection clamps of the pump control
- RSP 12, RSP 13 - Connection clamps for external conditions for boiler operation
- RSP 14, RSP 15 (**OPTIONAL**)- Sensor connection clamps for external conditions for boiler operation
- M - Ventilator

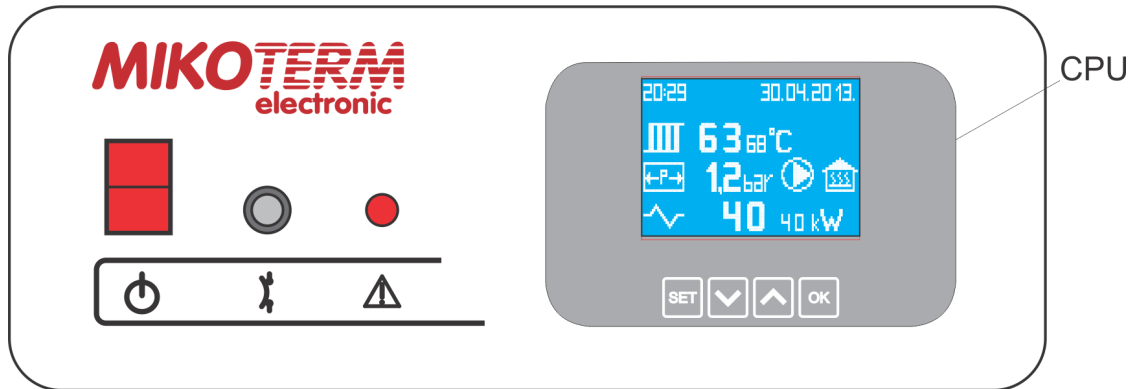Boiler boards



-  - The main switch - includes the boiler and provides a condition for the inclusion of heating groups.
-  - Safe thermostat with manual reset set to 95 ° C. If the temperature in the boiler reaches 95 ° C, this thermostat includes a safety relay, through which the safety circuits are activated. The power supply of the device is switched off so that the security of the device is complete.
-  - Thermal overload warning lamp (overheating) of the boiler. It turns on when the safety thermostat is activated.

CPU - Microprocessor thermoregulator - it is used by the operating temperature and power of the boiler, monitoring the current and current values of temperature and power, as well as the current system pressure, the circulation pump status (on / off) and the state of external operating conditions (allowed boiler operation / not permitted operation of the boiler). Communication with a microprocessor thermoregulator with 4 buttons.

The working principle

Temperature and hydraulic pressure sensors monitor changes in the system and send information to the microcontroller that processes them and controls the operation of the boiler.

Communication of the user with the device is facilitated and improved by displaying all the parameters of the system on the graphic LCD display and simple commanding with the four keys.

The operating temperature is set in steps of 1 ° C, it is possible to set the value in the range of 10 ÷ 90 ° C.

The power of the boiler is set in steps of 10kW, or the heaters are arranged in several heating groups (depending on the nominal boiler power). The switching on and off of the heating groups is successive, with a 3sec spacing with an engaged power divided by 3 degrees temperature shifted by 3 ° C. The heating groups do not have a certain sequence of inclusion, but the microprocessor makes a decision on their inclusion and exclusion based on the time of each heating group operation. Thus, a uniform distribution of the operating time of each heating group is achieved, resulting in a longer lifetime of the device.

The thermoregulator can also control the operation of the circulation pump. The pump is switched on when the external condition for the operation of the boiler (which is connected to the auxiliary terminals RSP 12 and RSP 13) is active. This is also a condition for the operation of heating groups. The pump remains switched on for 2 minutes after switching off the external operating conditions due to the heat dissipated heat transfer from the heater. The control voltage for switching the circulation pump (230V 50Hz) is sent to the auxiliary terminals RSP 10 and RSP 11. Also, the thermoregulator switches on the pump regardless of the external operating condition if the boiler temperature exceeds 90 ° C, in order to reduce the temperature in the boiler.

Running the boiler temperature to outdoor temperature - O.T.C. mode

In general, devices in this series can be ordered with a version of a microprocessor thermoregulator that has the ability to operate the boiler temperature according to the outdoor temperature - "Outdoor Temperature Compensation", hereinafter O.T.C. mode. In addition to the boiler, an external temperature sensor in the plastic protective box is installed, which is mounted on the outside of the building and connects with a 2-core cable with a boiler.

In OTC mode it is possible to set two independent curves (set with 5 reference points) and one fixed temperature. In this mode, the operation of the boiler is programmed at a 24-hour level, where it is possible to select one of two working curves or a fixed temperature value for each hour (Figure 1). In the example from Figure 1, in the period from 00 ÷ 06h, the boiler temperature will slip over the economic curve, during a period of 06-22h for a comfortable working curve, and in the period of 22 ÷ 24h, it will set the fixed value of the set temperature.

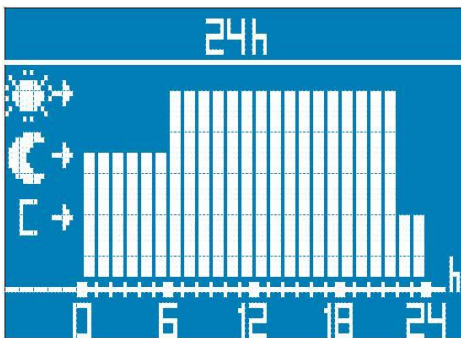


Image 1

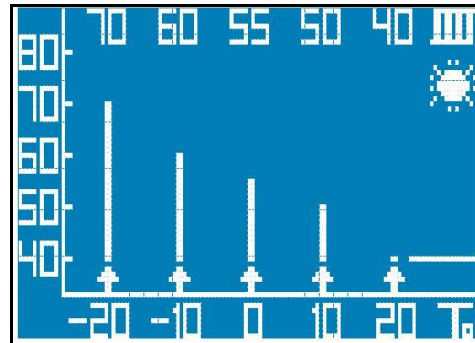


Image 2

A comfortable working curve (indicated by the symbol of the sun) is intended for use during the day. The economic curve (indicated by the symbol of the moon) for use during the night - when the outside temperatures are lower, but the lower the temperature of the heated space is needed, the application of the same curve that was used during the day would be uneconomical. Of course, this is only the most commonly used logic, and depending on the characteristics of the object, the type of heating system and other specific conditions, the periods of use of the working curves can be distributed in any way - it is possible to switch to the use of another curve or a fixed thermometer at any hour.

The working curves can be formed as desired - it is for the user to select the optimum form of working curves according to the particular object and the particular type of heating, as well as the periods in which they will be used.

Figure 2 shows the adjustment of the comfort curve. The values are set to 5 reference points:

- 1) External temp. $T_o = -20\text{ }^{\circ}\text{C} \rightarrow$ temp. boiler $70\text{ }^{\circ}\text{C}$
- 2) External temp. $T_o = -10\text{ }^{\circ}\text{C} \rightarrow$ temp. boiler $60\text{ }^{\circ}\text{C}$
- 3) External temp. $T_o = 0\text{ }^{\circ}\text{C} \rightarrow$ temp. boiler $55\text{ }^{\circ}\text{C}$
- 4) Outside temp. $T_o = 10\text{ }^{\circ}\text{C} \rightarrow$ temp. boiler $50\text{ }^{\circ}\text{C}$
- 5) Outside temp. $T_o = 20\text{ }^{\circ}\text{C} \rightarrow$ temp. boiler $40\text{ }^{\circ}\text{C}$

The microcontroller "merging" these 5 points generates a curve that will "slide" the boiler's boom temperature. In the same way, another (economical) work curve is assigned. The principle of forming a working curve is such that it is possible to set a practically unlimited number of curves of different forms. This way of setting labor curves, as well as the possibility of combining them, makes the OTC a word applicable in every concrete situation, on objects different for their purpose, type of heating system, spatial orientation, etc. If necessary, the user can execute corrections of the initially assigned working curves, as well as 24h programming, in a simple and quick way, adjust the boiler, and therefore the whole heating system to obtain optimal heating comfort in the most economical way.